

# STATEWIDE MARKING GUIDELINES *for Facility Owner*

The following Statewide Marking Guidelines may be used by member facility owners.



- Width of each mark should be approximately 2".
- Length of each mark should be approximately 12" – 18".
- Distance between marks depends on site conditions, but no greater than 20'.
- Company identification painted at reasonable intervals to allow quick identification.
- End marks should contain arrows if line continues.
- The size of any painted text will does not expand the tolerance zone.




## MARKING SAMPLES

*(Company names used below are for illustrative purposes only.)*


### LINE

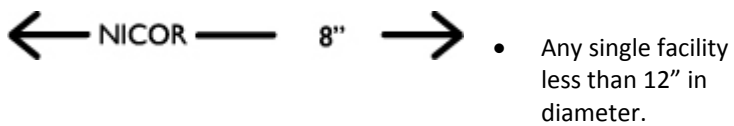

### CORRIDOR

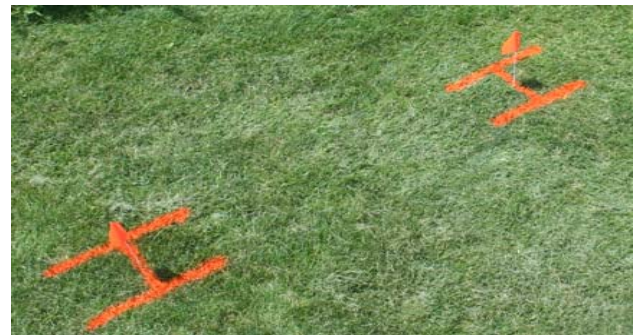


### OVERSIZED

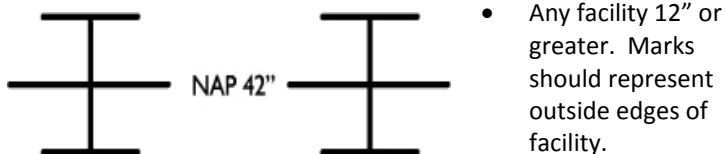


**DUCT PACKAGE**



- Marks should represent outside edges whenever possible.

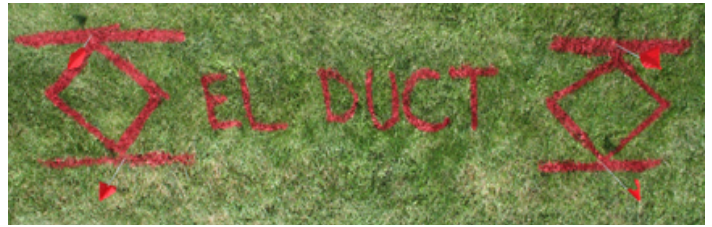


**HIGH PRESSURE GAS LINES**




- Company should indicate that the line is high pressure gas.



**TERMINATION POINT**



**OFFSETS**

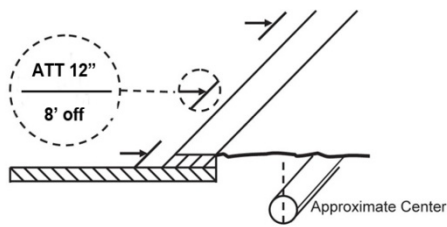

- Used when marks cannot be placed directly above buried facility.



**NO CONFLICT**

**NO/COMED**  
**NICOR/OK**

- Recommend company name with the word NO.
- Recommend company name with the word OK.



### BURIED SPLICES, VALVES, MANHOLE LIDS



- Circle should represent approximate size of buried facility.



### STREET LIGHTS



### TRAFFIC CONTROL

